


IG495C

INDUSTRIAL RANGE
POWER BY CUMMINS

IGNT

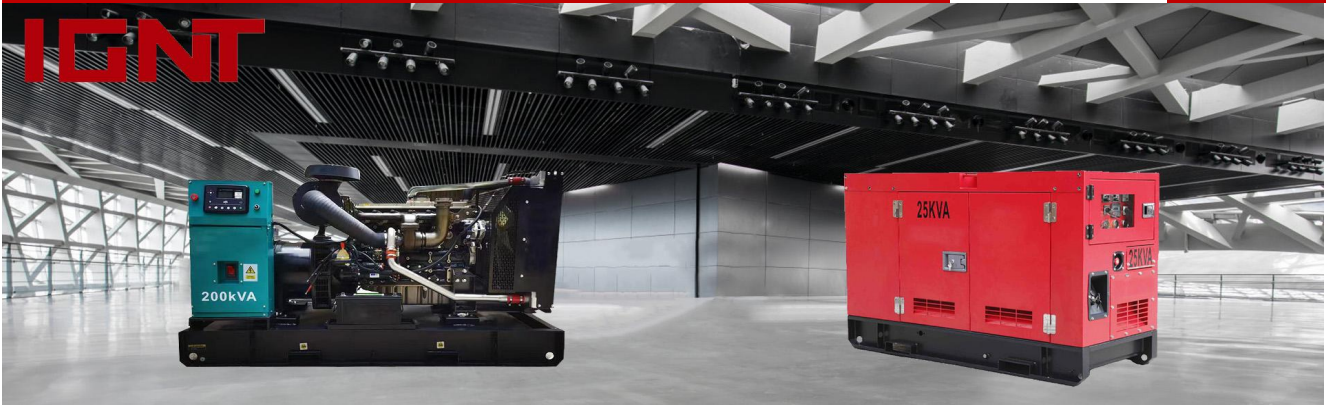

POWER DEFINITION

PRP: Prime Power is required for continuous operation under variable load and infinite operating hours per year.

ESP: Standby power refers to the ability of the generator to operate at varying loads in the event of power outage, with an annual operating time of up to 200h.

STANDARD USAGE CONDITIONS:

1. Altitude: below 1000 meters;
2. Environmental temperature: 25 °C
3. Relative humidity: 30%

ABOUT NOISE:

The noise level of the generator largely depends on the installation conditions and usage environment, so it is not possible to specify the noise value in manual. The noise value we provide is based on laboratory testing and is for reference.

QUALIFICATION STANDARD

IGNT POWER generator set complies with ISO and CE standards, which also include the following certification standards:
ISO 1400:2015 Environmental System;
ISO 45001:2018 Safty System;
ISO 9001:2015 Quality System

	SERVICE	PRP	ESP
Power	KVA	450	495
Power	KW	360	396
Standard Voltage	V	400/230	
Available Voltage	v	380/220	415/240
Rated Current	A	650	
Frequency/Speed	HZ/RPM	50/1500	

Weight and Dimension

	Dimension	Open	Silent
Length	(L) mm	3500	4590
Width	(W) mm	1300	1600
Height	(H) mm	2050	2500
Net Weight	KG	3370	4820
Fuel Tank	L	690	

IG495C

INDUSTRIAL RANGE
POWER BY CUMMINS

IGNT

Engine Specifications

General Engine Data -- CUMMINS CCEC		
Engine Model	6ZTAA13-G4	
Governer	E	
Aspiration	Turbo, Water/Air cooling	
No. of Cylinders	6	
Displacement (L)	10.8	
Bore* Stroke (mm)	130*163	
Compression Ratio	17	
Rated Net Power(KW)	360	
Rated speed	1500 r/min	

Air intake system		
Maximum intake air restriction with heavy duty air cleaner:	/	
Air flow	kg/min	28.8

Lubrication System		
Engine Oil Capacity	L	45.4
Oil Consumption	g/kWh	0.5
Oil Pressure	kPa	82.7

Alternator Specifications

Alternator Date-- IGNT		
Alternator Model	IA544B	
Phase	3	
Voltage (V)	400	
Prime Power (KW)	450	
Pole	4	
Excitation System	Self-excited, Brushless	
No. of Bearing	1	
Power Factor	0.8	
Wiring Connection	3 Phases, 4 Wires	
Insulation Grade	H/H	
Protection Grade	IP23	
Voltage Regulation (%)	±0.5	

Fuel System		
Fuel Consumption @100% ESP	L/h	/
Fuel Consumption @100% PRP	L/h	91.4
Fuel Consumption @75% PRP	L/h	66.9
Fuel Consumption @50% PRP	L/h	44.3
Fuel Tank Capacity (Open)	L	780
Fuel Tank Capacity (Silent)	L	/

Starter System		
Start Motor Voltage	V	24
No. of Batteries	2	

Cooling System		
Engine Coolant Capacity	L	23.1
Thermostat Operating Range	°C	82
Max. Water Temp.	°C	102
Min. Pressure Cap	kPa	/

Exhaust system		
Max.exhaust temperature	°C	653
Exhaust gas flow	kg/min	30.1
Max.allowed back pressure	kPa	13

Alternator Date-- Stamford		
Alternator Model	S4L1D-G41	
Phase	3	
Voltage	V	400
Prime Power	KW	450
Pole	4	
Excitation System	Self-excited, Brushless	
No. of Bearing	3	
Power Factor	0.8	
Wiring Connection	3 Phases, 4 Wires	
Insulation Grade	H/H	
Protection Grade	IP23	
Voltage Regulation	%	±0.5

Controller Specifications

Control Panel Date-- Deepsea DSE6120

- | | |
|--|--|
| ● Built in PLC logic programming | ● Generator/load current monitoring and protection |
| ● Generator voltage detection | ● Fuel pump control function |
| ● Mains voltage detection | ● Can connect to all expansion modules |
| ● Generator/load power detection (kW, kVA, kVAr, pf) | ● Capable of graded loading |
| ● Generator overload protection (kW) | ● Engine speed protection |
| ● Equipped with manual closing and opening functions | ● Engine preheating |
| ● Start gen-set when the battery voltage is low | ● Engine starts rapidly&stops rapidly |
| ● LCD and LED alarm indication | ● Custom remote start signal |

Generator Specifications

Standard Configuration

- 50°C radiator for belt driven fan
- 12/24V charging alternator
- One set of air/fuel/oil filters
- Chassis with integrated fuel tank
- Emergency stop button
- Anti-vibration shock absorbers
- Main circuit breaker/ MCCB
- Auto control system
- User manual

Optional Configuration

- Battery charger
- Engine pre-heater
- Alternator pre-heater
- PMG/ AREP/ MAUX
- Water-oil separator
- Inside automatic transfer switch/ ATS box
- Grounding copper rod
- Remote control system
- Switch box

Warranty of Generator Set

Cummins Engine

One year or 1000 running hours whichever comes first

Generator

One year or 1000 running hours whichever comes first

Email: ignt@igntpower.com

Web: www.igntpower.com

11-11-2023 10:00 AM

